




REPERE	F1	QG	Q1	Q2	Q3	Q4						
INTENSITE	STI UNI+N	NS630N 4P4D										
TENSION	230V	400VTRI+N										
DIFFERENTIEL												
SECTION												

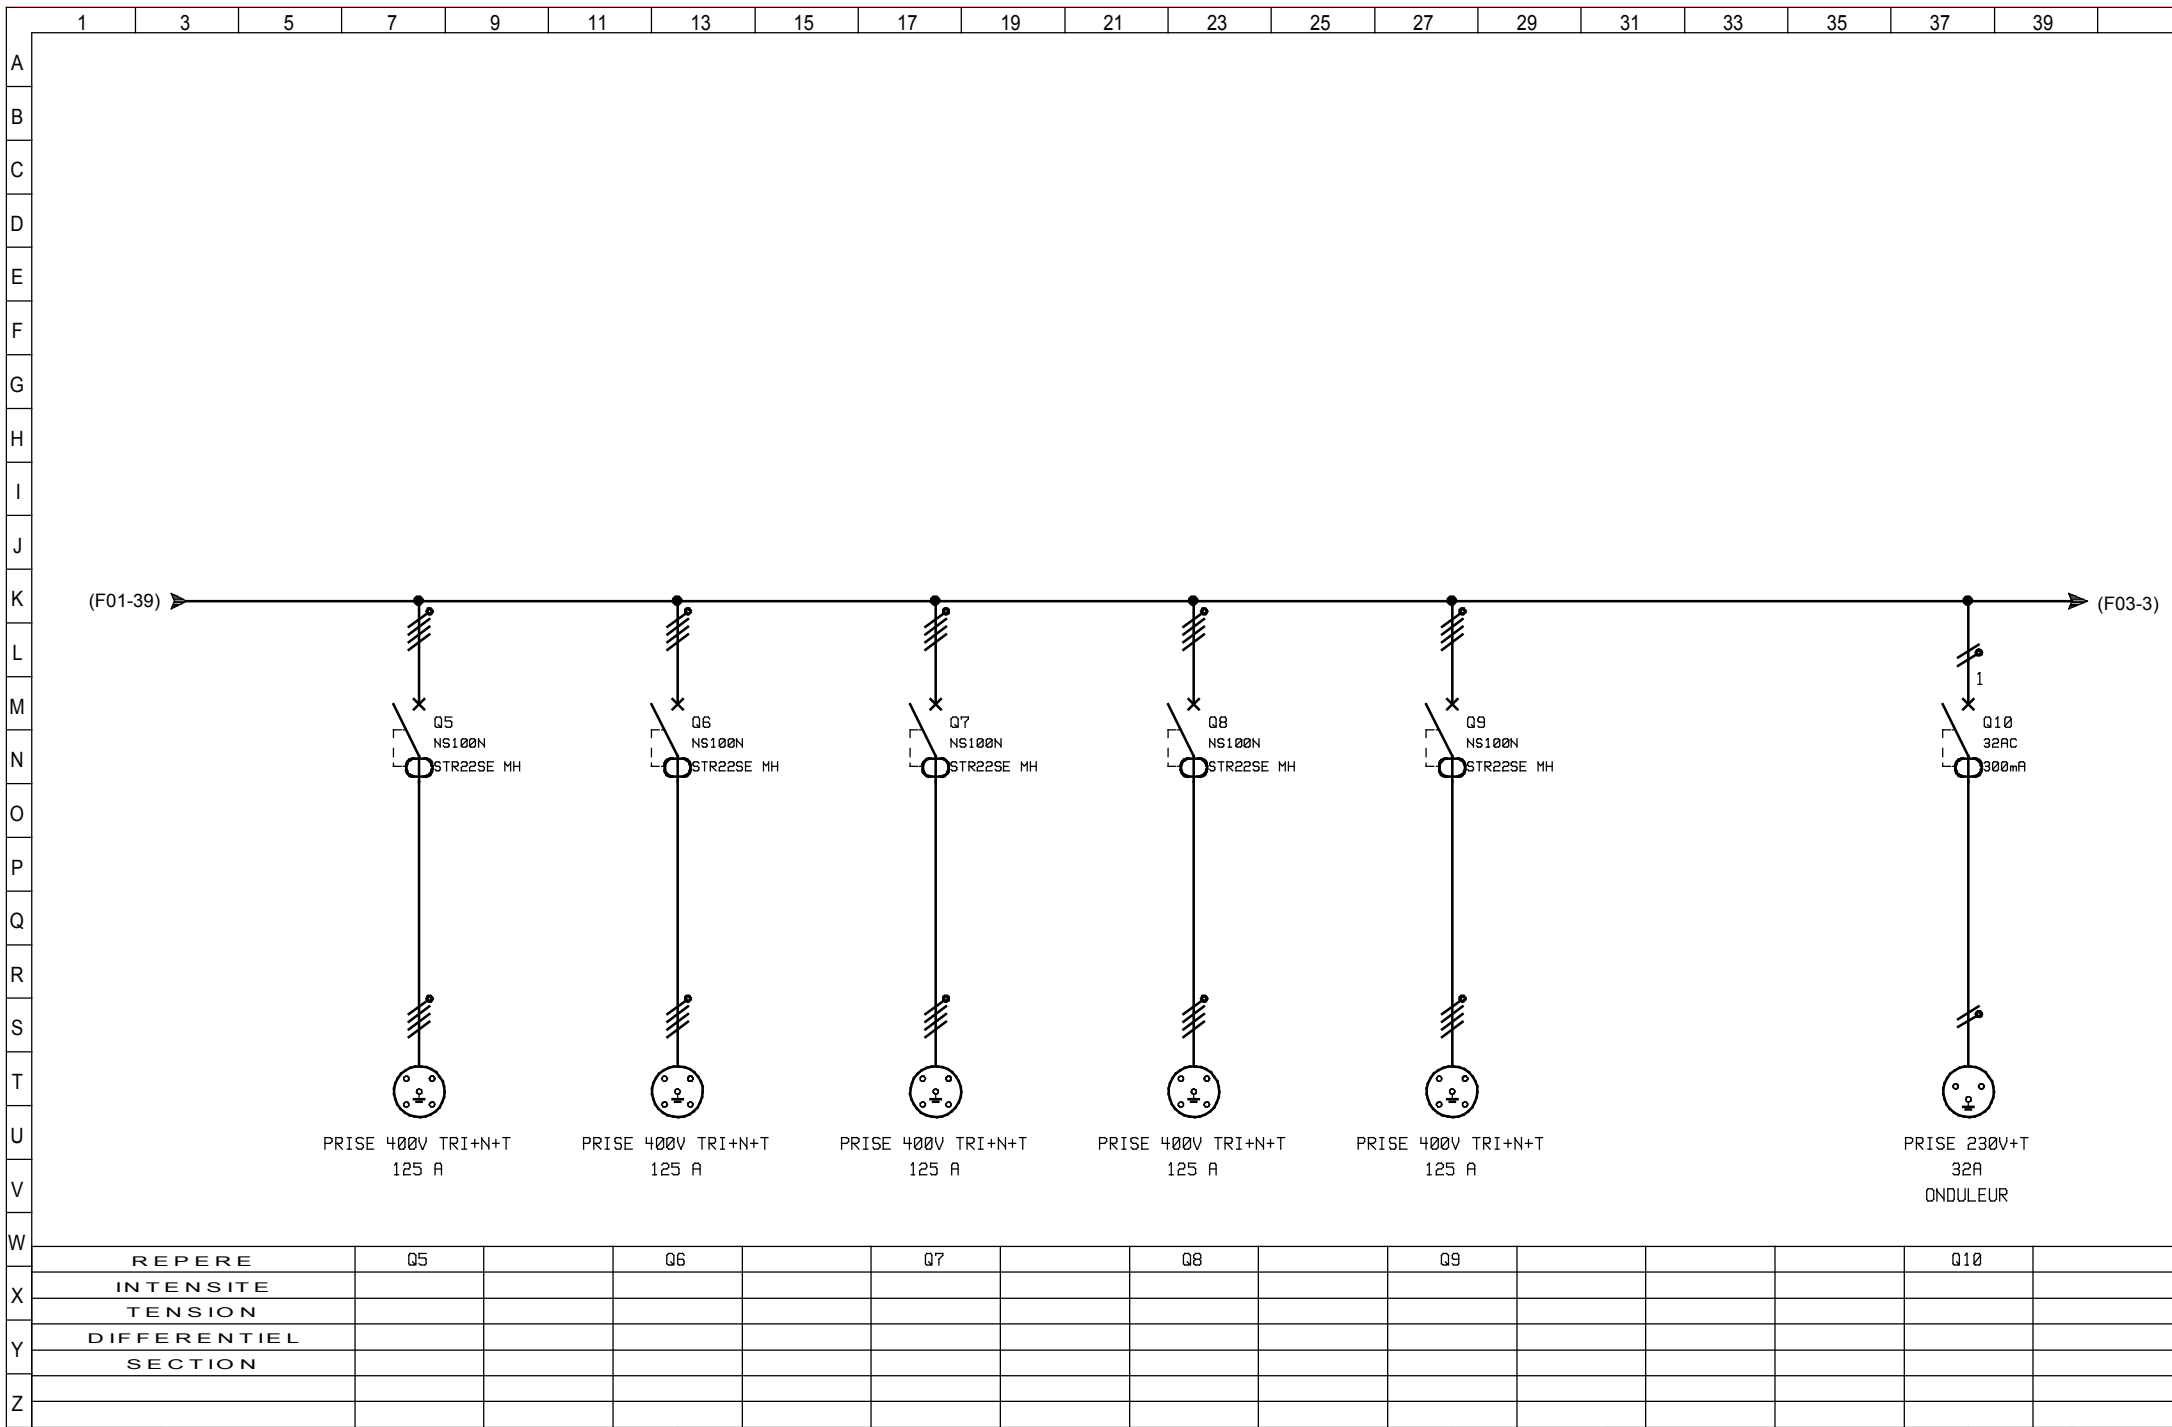

REPERE	Q5		Q6		Q7		Q8		Q9				Q10	
INTENSITE														
TENSION														
DIFFERENTIEL														
SECTION														

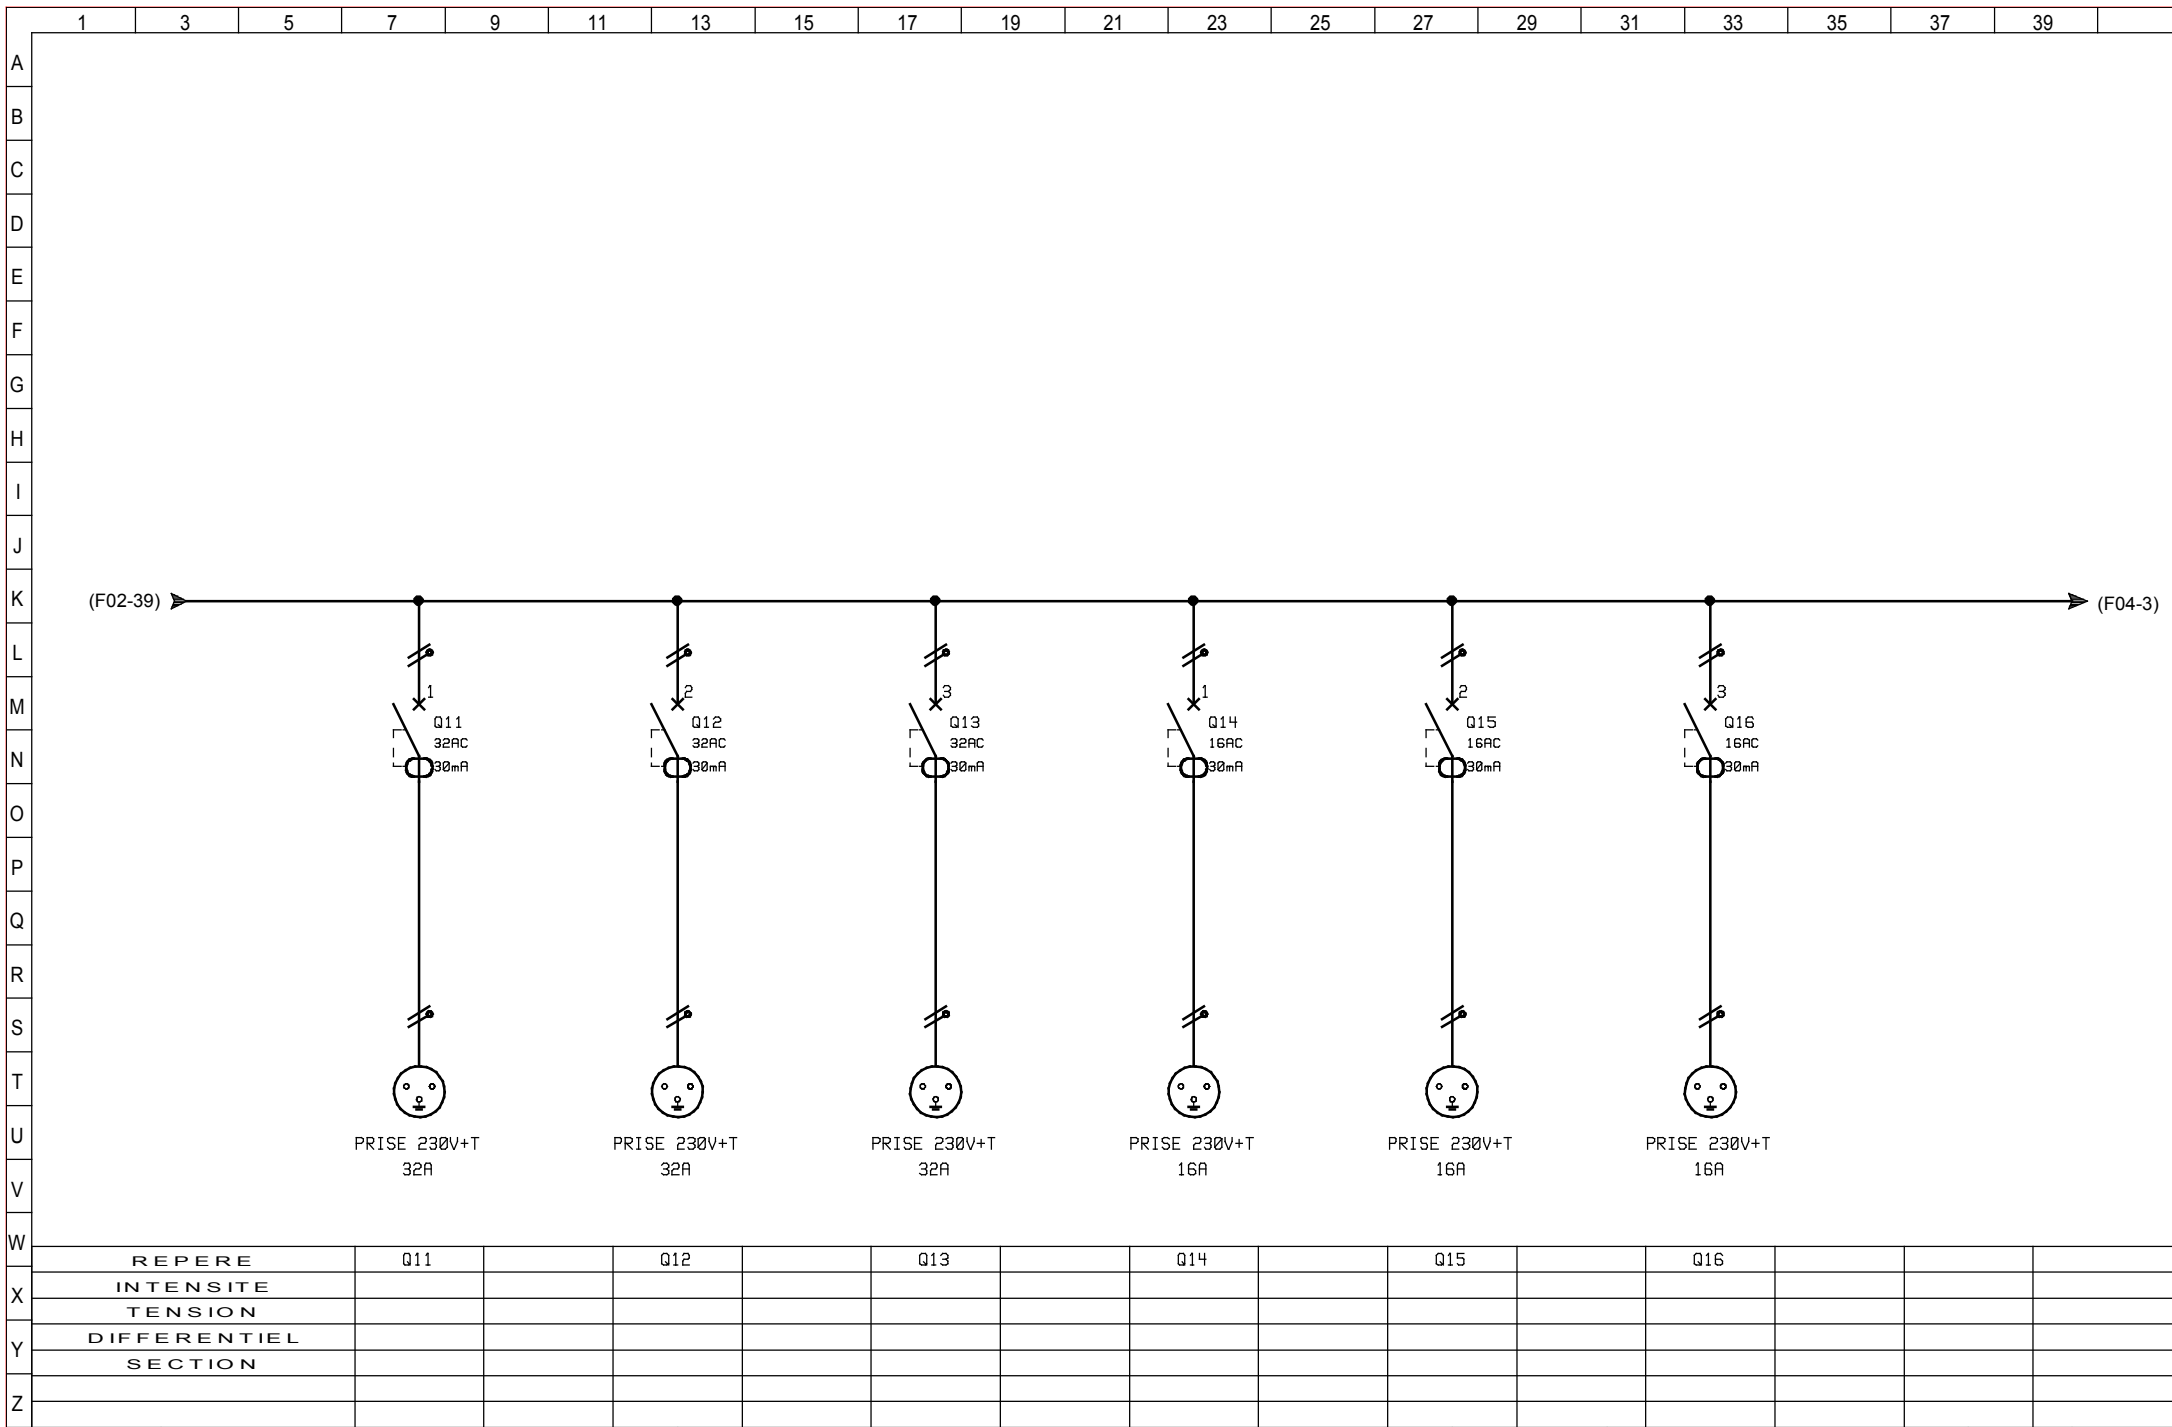

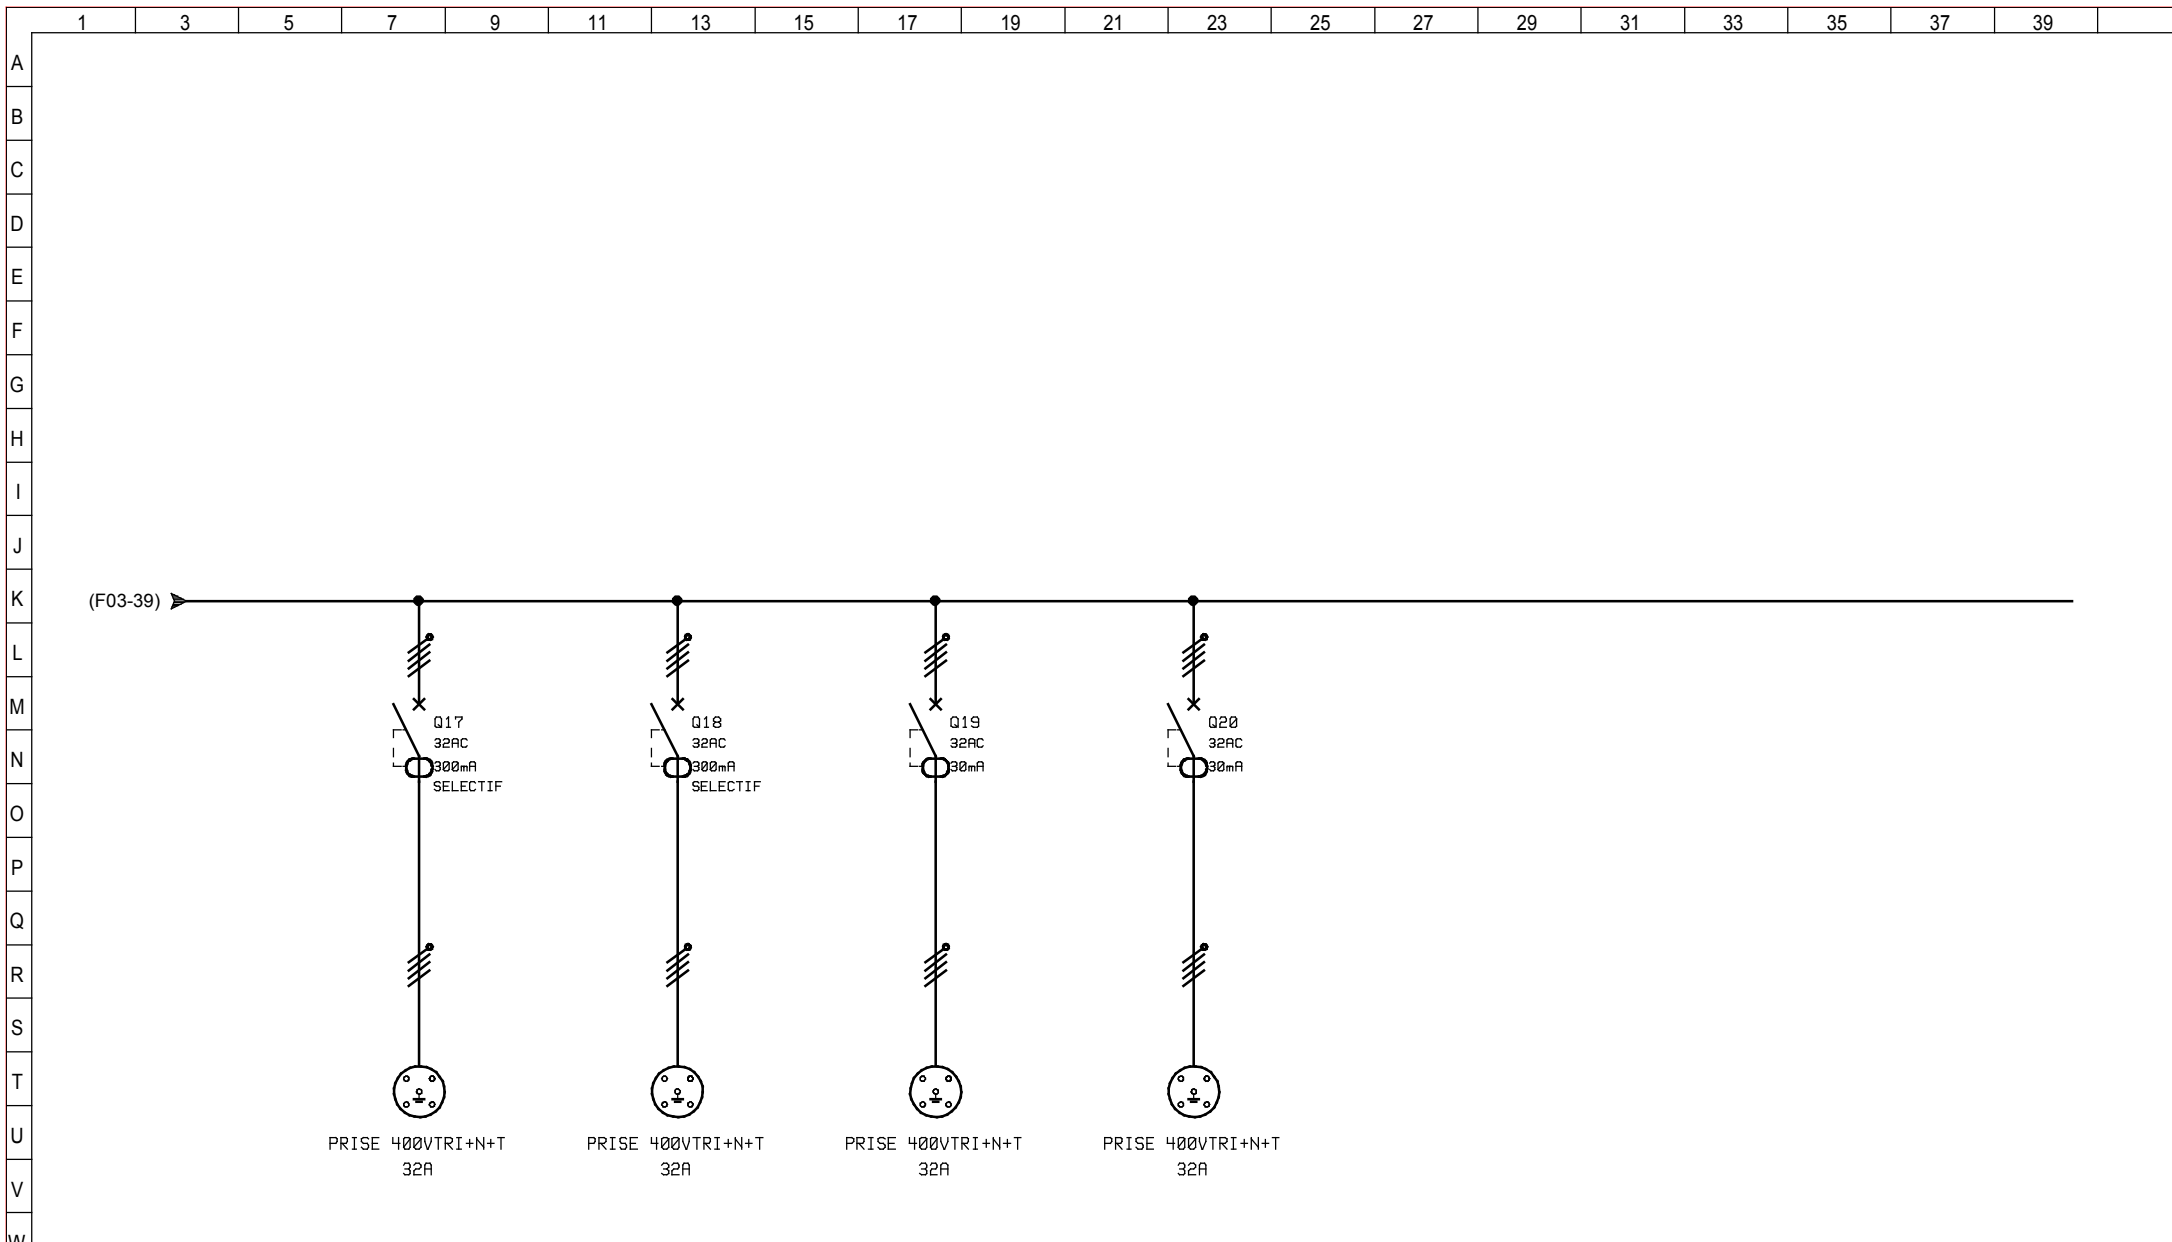

REPERE	Q17		Q18		Q19		Q20							
INTENSITE														
TENSION														
DIFFERENTIEL														
SECTION														

